AL600UL3 AL600UL3X

Triple Output Power Supply/Charger

Installation Guide

For a red enclosure add an "R" suffix to the part #, e.g. AL600UL3R



Address: _

Phone #:

Overview:

Altronix AL600UL3/AL600UL3X Triple Output Power Supply/Charger is specifically designed for use with access control and fire-protective signaling systems and accessories. AL600UL3/AL600UL3X converts a 115VAC 60Hz input into three (3) outputs (see specifications).

Feat	ures:
Agency Listings:	Battery Backup:
UL Listed: UL294 Access Control Systems	 Built-in charger for sealed lead acid or gel type batteries.
UL1481 Power Supplies for Fire	 Automatic switch over to stand-by battery
Protective Signaling Systems.	when AC fails.
cUL Listed:	Maximum charge current 0.7A.
CSA Standard C22.2 No.205-M1983,	 Zero voltage drop when switched over to
Signal Equipment.	battery backup.
 MEA - NYC Department of Buildings Approved. 	Supervision:
• CSFM - California State Fire Marshal Approved.	AC fail supervision (form "C" contacts).
NFPA 72 Compliant (Fire Destertion Complex)	 Low battery and battery presence supervision
(Fire-Protective Signaling Service).	(form "C" contacts).
Input:	Additional Features:
 Input 115VAC, 60Hz, 3.5A. Input fuse roted @ 54/250V/ 	• Power supply, enclosure, cam lock and battery leads.
Input fuse rated @ 5A/250V.	Enclosure Dimensions (H x W x D):
Output:	AL600UL3:
 Class 2 Rated power-limited outputs (5VDC and 12VDC only). 	13.5" x 13" x 3.25"
 1.75A continuous supply current at 5VDC. 	(342.9mm x 330.2mm x 82.6mm).
 1.75A continuous supply current at 12VDC. 	Accommodates up to two (2) 12VDC/7AH batteries.
• 3A continuous supply current at 24VDC.	AL600UL3X:
 100 mV p/p output ripple. 	15.5" x 12" x 4.5"
 Filtered and electronically regulated output(s). 	(393.7mm x 304.8mm x 114.3mm).
 Short circuit and thermal overload protection. 	Accommodates up to two (2)
LED Indicators:	12VDC/12AH batteries.
 AC input, DC output and Battery LED indicators. 	

*Access Control Performance Levels: Destructive Attack - I; Endurance - IV; Line Security - I; Stand-by Power - IV.

Stand-by Specifications (Current is specified on AL3XB input):				
Output	4 hr. of Stand-by and 5 Minutes of Alarm	24 hr. of Stand-by and 5 Minutes of Alarm	60 hr. of Stand-by and 5 Minutes of Alarm	
	5VDC - 1.75A	5VDC - 0.3A	5VDC - 0.1A	
24VDC / 40AH Battery	12VDC - 1.75A	12VDC - 0.3A	12VDC - 0.1A	
	24VDC - 3A	24VDC - 0.3A	24VDC - 0.1A	

Easturasi

- 2 -

Installation Instructions:

Wiring methods shall be in accordance with the National Electrical Code/NFPA 70/NFPA 72/ANSI, and with all local codes and authorities having jurisdiction. Product is intended for indoor use only.

 Mount unit in the desired location. Mark and predrill holes in the wall to line up with the top two keyholes in the enclosure. Install two upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the two upper screws, level and secure. Mark the position of the lower two holes. Remove the enclosure. Drill the lower holes and install the three fasteners. Place the enclosure's upper keyholes over the two upper screws. Install the two lower screws and make sure to tighten all screws (Enclosure Dimensions, pgs. 7-8). Secure enclosure to earth ground.

It is recommended to first review the following tables for screw terminals, switch selection and LED status indications. This will greatly facilitate installation hook-up.

Car	efully	revie	W:

Stand-by Specifications	(pg. 2)
LED Diagnostics	(pg. 4)
Terminal Identification Table	(pg. 4)

 Connect AC power (115VAC 60Hz) to the terminals marked [L, N] (*Fig. 1, pg. 5*). Green "AC" LED on power supply board will turn on. This light can be seen through the LED lens on the door of the enclosure. Secure green wire lead to earth ground.

Use 18 AWG or larger for all power connections (Battery, DC output).

Use 22 AWG to 18 AWG for power-limited circuits (AC Fail/Low Battery reporting).

Keep power-limited wiring separate from non power-limited wiring (115VAC / 60Hz Input, Battery Wires). Minimum 0.25" spacing must be provided.

For Fire Alarm applications the outputs are "Special Applications" only, see list (refer to Appendix A, pg. 6).

- 3. Measure output voltage before connecting devices. This helps avoiding potential damage.
- 4. Connect devices to be powered at 5VDC to the terminals marked [+ 5VDC -].
- 5. Connect devices to be powered at 12VDC to the terminals marked [+ 12VDC -].
- 6. Connect devices to be powered at 24VDC to the terminals marked [+ 24VDC -].
- 7. Connect two (2) 12V Stand-by batteries.

Note: For Access Control applications batteries are optional. When batteries are not used, a loss of AC will result in the loss of output voltage. Batteries must be lead acid or gel type if used.

Use two (2) 12V stand-by batteries connected in series to the terminals marked [+ BAT -] (*Fig.* 1, pg. 5). 8. It is required to connect supervisory trouble reporting devices to outputs marked [AC FAIL, LOW BAT] (*Fig.* 1), pg. 5).

Use 22 AWG to 18 AWG for AC Fail and Low Battery reporting. AC Failure will report in 5 minutes. **Note:** When used in fire alarm, burglar alarm or access control applications, "AC Fail" relay should be utilized to visually indicate that AC power is on. To delay report for 6 hours cut "AC Delay" jumper *(Fig. 1a, pg. 5)*.

9. Please ensure that the cover is secured with the provided key lock.

Wiring:

Use 14 AWG or larger for all power connections. **Note:** Take care to keep power-limited circuits separate from non power-limited wiring (115VAC, Battery).

Maintenance:

Unit should be tested at least once a year for the proper operation as follows:

 Output Voltage Test:
 Under normal load conditions, the DC output voltage should be checked for proper voltage level (refer to Power Supply Voltage Output Specifications chart).

 Battery Test:
 Under normal load conditions check that the battery is fully charged, check specified

voltage both at the battery terminal and at the board terminals marked [+ BAT –] to ensure that there is no break in the battery connection wires.

Note: Maximum charging current under discharge is 0.7A.

Note: Expected battery life is 5 years, however it is recommended changing batteries in 4 years or less if needed.

LED Diagnostics:

AL600ULXB - Power Supply			
Red (DC)	Green (AC)	Power Supply Status	
ON	ON	Normal operating condition.	
ON	OFF	F Loss of AC. Stand-by battery is supplying power.	
OFF	ON	No DC output.	
OFF	OFF	OFF Loss of AC. Discharged or no stand-by battery. No DC output.	
Red (Bat)	Battery Status		
ON	Normal operating	Normal operating condition.	
OFF	Battery fail/low b	attery.	

Terminal Identification:

AL600ULXB - Power Supply

Terminal Legend	Function/Description	
L, N	115VAC, 60Hz	
+ DC -	24VDC @ 6A total continuous output (supplies power to ALX3B).	
AC Fail NC, C, NO	Indicates loss of AC power, e.g. connect to audible device or alarm panel. Relay normally energized when AC power is present. Contact rating 1A @ 28VDC.	
Bat Fail NC, C, NO	NO Indicates low battery condition, e.g. no battery presence. Relay normally energized when DC power is present. Contact rating 1A @ 28VDC. Low battery threshold: 24VDC. Output threshold is set approximately @ 21VDC	
+BAT -	Stand-by battery connections. Maximum charge current 0.7A.	

ALX3B - Power Output Module


Terminal Legend	Function/Description	
+ INPUT -	24VDC from power supply (AL600ULXB).	
+ 24VDC -	24VDC @ 3A continuous power-limited output	
+ 12VDC -	12VDC @ 1.75A continuous power-limited output.	
+ 5VDC -	5VDC @ 1.75A continuous power-limited output.	

Fig. 1 - AL600UL3

CAUTION: De-energize unit prior to servicing.

For continued protection against risk of electric shock and fire hazard replace fuse with the same type and rating.

Do not expose to rain or moisture.

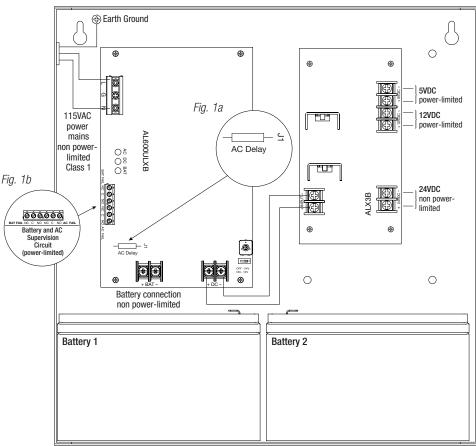

A.1 Four (4) Wire Smoke Detectors Table A-1 below lists four (4) wire smoke detectors compatible with AL600UL3/AL600UL3X output.

System Sensor Smoke Detector/Base	Detector Type	Max Stand-by Current (mA)	Alarm Current (mA)
B112LP	Base	0.12	36
B114LP	Base	*	*
B404B	Base	*	*
DH100ACDC	Photoelectric	0.15	0.70
DH100ACDCLP	Photoelectric	0.15	0.70
DH100ACDCLPW	Photoelectric	0.15	0.70
DH400ACDCI	Ionization Duct	25	95
DH400ACDCP	Photoelectric Duct	25	95
1112/24/D	Ionization	0.05	50
1424	Ionization	0.10	41
1451 (w/B402B Base)	Ionization	0.10	39
2112/24ATR	Photoelectric	0.50	60/70
2112/24AITR	Photoelectric	0.50	60/70
2112/24/D	Photoelectric	0.05	50
2112/24T/D	Photoelectric w/135° Thermal	0.05	50
2112/24TSRB	Photoelectric w/135° Thermal Supervisory Relay	15	45
2312/24TB	Photoelectric	0.12	50
2412 (12 volt)	Photoelectric	0.12	77
2424	Photoelectric	0.10	41
2451	Photoelectric	0.10	39
2451TH (with/B402B Base)	Photoelectric	0.10	39
2W-MOD	Loop Test/Maintenance Mod.	30	50
4W-B (12/24 volt)	Photoelectric I ³	0.05	23
4WT-B (12/24 volt)	Photoelectric I ³ w/Therm	0.05	23
4WTA-B (12/24 volt)	I ³ Photo w/Therm/Sounder	0.05	35
4WTR-B (12/24 volt)	I ³ Photo w/Therm/Relay	0.05	35
4WITAR-B (12/24 volt)	I ³ Photo w/Isolated Therm/Sounder/Relay	0.05	50
2W-MOD2	I ³ Loop Test/Maintenance Mod.	0.05	*
RRS-MOD	I ³ Reversing Relay/Sync Module	0.05	*
6424	Projected Beam	10	28.4
Beam 1224(S)	Projected Beam	17	38.5

* Contact manufacturer for current draws.

A.2 Relays

Table A-2 below lists relays compatible with AL600UL3/AL600UL3X output.


Manufacturer	Model	Current (mA)
	PR-1	15
	PR-2	30
Sustam Canoor	PR-3	30
System Sensor	EOLR-1	30
	R-10T	23
	R-14T	23


Manufacturer	Model	Current (mA)
System Sensor	R-20T	40
	R-24T	40
	R-10E	23
	R-14E	23
	R-20E	40
	R-24E	40

AL600UL3 / AL600UL3X Installation Guide

Enclosure Dimensions (BC300): AL600UL3


13.5" x 13" x 3.25" (342.9mm x 330.2mm x 82.6mm)



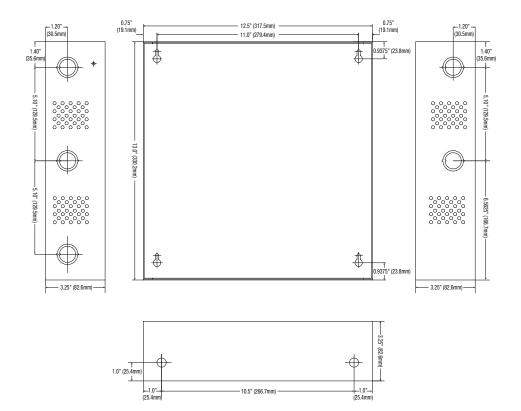

Enclosure Dimensions (BC400): AL600UL3X

15.5" x 12" x 4.5" (393.7mm x 304.8mm x 114.3mm)

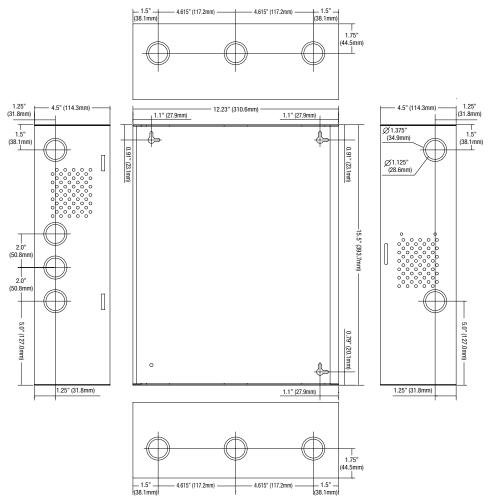

Altronix is not responsible for any typographical errors.

140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056 website: www.altronix.com | e-mail: info@altronix.com | Lifetime Warranty IIAL600UL3/AL600UL3X G07U

