

Access & Power Integration

Altronix/Software House Kits

Models Include:

T2SK78V

8 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove2 enclosure with TSH2 Altronix/Software House backplane
- One (1) AL1024XB2V Power Supply/Charger
- One (1) ACM8 Fused Access Power Controller
- One (1) VR6 Voltage Regulator
- One (1) PDS8 Dual Input Fused Power Distribution Module
- One (1) Rocker Switch Bracket with One (1) Rocker Switch

T3SK758V

8 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove3 enclosure with TSH3 Altronix/Software House backplane
- One (1) AL1024XB2V Power Supply/ChargerOne (1) AL1012XB220 Power Supply/Charger
- One (1) ACM8 Fused Access Power Controller
- One (1) PD8UL Fused Power Distribution Module
- One (1) Rocker Switch Bracket with Two (2) Rocker Switches

T3SK7516V

16 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove3 enclosure with TSH3 Altronix/Software House backplane
- One (1) AL1024XB2V Power Supply/Charger
- One (1) AL1012XB220 Power Supply/Charger
- Two (2) ACM8 Fused Access Power Controllers
- One (1) PD8UL Fused Power Distribution Module
- One (1) Rocker Switch Bracket with Two (2) Rocker Switches

T2SK78DV

8 Door Kit with PTC Outputs

Fully assembled kit includes:

- Trove2 enclosure with TSH2 Altronix/Software House backplane
- One (1) AL1024XB2V Power Supply/Charger
- One (1) ACM8CB PTC Access Power Controller
- One (1) VR6 Voltage Regulator
- One (1) PDS8CB Dual Input PTC Power Distribution Module
- One (1) Rocker Switch Bracket with One (1) Rocker Switch

T3SK758DV

8 Door Kit with PTC Outputs

Fully assembled kit includes:

- Trove3 enclosure with TSH3 Altronix/Software House backplane
- One (1) AL1024XB2V Power Supply/Charger
- One (1) AL1012XB220 Power Supply/Charger
- One (1) ACM8CB PTC Access Power Controller
- One (1) PD8ULCB PTC Power Distribution Module
- One (1) Rocker Switch Bracket with Two (2) Rocker Switches

T3SK7516DV

16 Door Kit with PTC Outputs

Fully assembled kit includes:

- Trove3 enclosure with TSH3 Altronix/Software House backplane
- One (1) AL1024XB2V Power Supply/Charger
- One (1) AL1012XB220 Power Supply/Charger - Two (2) ACM8CB - PTC Access Power Controllers
- One (1) PD8ULCB PTC Power Distribution Module
- One (1) Rocker Switch Bracket with Two (2) Rocker Switches

Please refer to the included corresponding Sub-Assembly Installation Guides for further information.

Installation Guide



All registered trademarks are property of their respective owners.

Rev. TSKLV052323





Overview:

Altronix Trove Software House kits are pre-assembled and consist of Trove enclosure with factory installed Altronix power supply/chargers and sub-assemblies. These kits also accommodate various combinations of Software House boards for up to twenty four (24) doors in a single enclosure.

Configuration Chart:

| Altronix Model Number | 220VAC 60Hz Input Current (A) | Power Supply Board Input Fuse Rating | Power Supply Board Battery Fuse Rating | Nominal I Voltage Power Supply 1 24VDC Output Range (V) | | Maximum Supply Current for Main Output on Power Supply board and ACM8(CB) Access Power Controller's outputs (A) | Fail- Safe/ Fail- Secure Outputs | Current Per ACM8(CB) Output (A) | ACM8(CB) Board Input Fuse Rating | ACM8(CB) Board Output Fuse (PTC) Rating | PDS8(CB) Board Input Fuse (PTC) Rating | PDS8(CB) Board Output Fuse (PTC) Rating | PD8UL(CB) Board Output Fuse (PTC) Rating |
|-----------------------------|---|---|---|--|-----------|---|--|------------------------------------|-------------------------------------|--|---|--|---|
| T2SK78V | 2.5 | 5A/ 250V | 15A/ 32V | 20.17-26.4 | _ | 24VDC @ 9.2A | 8 | 2.5 | 10A/ 250V | 3.5A/ 250V | 10A/ 32V | 3A/ 32V | |
| T2SK78DV | | | | | | | | 2.0 | 10A/ 250V | 2.5A | 9A | 2.5A | 1 - |
| T3SK758V | 3.8 | 5A/ 250V | 15A/ 32V | 20.19-26.4 | 10.0-13.2 | 24VDC @ 9.2A | 8 | 2.5 | 10A/ 250V | 3.5A/ 250V | | _ | 3.5A/ 250V |
| T3SK758DV | | | | | | | | 2.0 | 10A/ 250V | 2.5A | | | 2.5A |
| T3SK7516V | 3.8 | 5A/ 250V | 15A/ 32V | 20.19-26.4 | 10.0-13.2 | 24VDC @ 9.2A | 16 | 2.5 | 10A/ 250V | 3.5A/ 250V | | | 3.5A/ 250V |
| T3SK7516DV | | | | | | | | 2.0 | 10A/ 250V | 2.5A | _ | _ | 2.5A |

Hardware and Accessories:


Metal or Nylon Spacer | 5/16" Pan Head Screw | Lock Nut

- Tamper switch (Altronix Model TS112 or equivalent) one (1) for T2SK78(D)V, two (2) for T3SK758(D)V or T3SK7516(D)V.
- · Cam lock.
- Battery leads.

Installation Instructions:

Wiring methods shall be in accordance with the National Electrical Code/NFPA 70/ANSI, and with all local codes and authorities having jurisdiction. Product is intended for indoor use only.

- 1. Remove backplane from enclosure. Do not discard hardware.
- 2. Mark and predrill holes in the wall to line up with the top three keyholes in the enclosure. Install three upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the three upper screws, level and secure. Mark the position of the lower three holes. Remove the enclosure. Drill the lower holes and install the three fasteners. Place the enclosure's upper keyholes over the three upper screws. Install the three lower screws and make sure to tighten all screws.
- 3. Mount included UL Listed tamper switch (Altronix Model TS112 or equivalent) in desired location, opposite hinge. Slide the tamper switch bracket onto the edge of the enclosure approximately 2" from the right side (*Fig. 1, pg. 2*). Connect tamper switch wiring to the Access Control Panel input or the appropriate UL Listed reporting device. To activate alarm signal open the door of the enclosure.
- 4. Mount Software House boards to backplane, refer to pages 3-5.
- 5. Refer to the XBV Power Supply/Charger Installation Guide for AL1012XB220 and AL1024XB2V and corresponding Sub-Assembly Installation Guides for the following models: PD8UL(CB), ACM8(CB), PDS8(CB), VR6 for further installation instructions.



T2SK78V and T2SK78DV: Configuration of Software House iSTAR Ultra ACM or ACM SE Boards


- 1. Align the Software House boards on the backplane to match the boards' mounting holes with corresponding pems.
- 2. Fasten spacers (provided) to pems that match the hole pattern for Software House iSTAR Ultra GCM, iSTAR Ultra ACM, iSTAR Ultra ACM SE and/or I8, R8, I8-CSI boards (*Fig. 2, 2a, pg. 3*).
- 3. Mount Software House boards to spacers utilizing provided 5/16" pan head screws (Fig. 2a, pg. 3).

Note: Software House iSTAR Ultra ACM and iSTAR Ultra ACM SE boards have one (1) USB port each.

Please orient the board in the appropriate position according to the *Fig. 2* below.

4. Fasten backplane to Trove2 enclosure utilizing lock nuts (provided).

Fig. 2

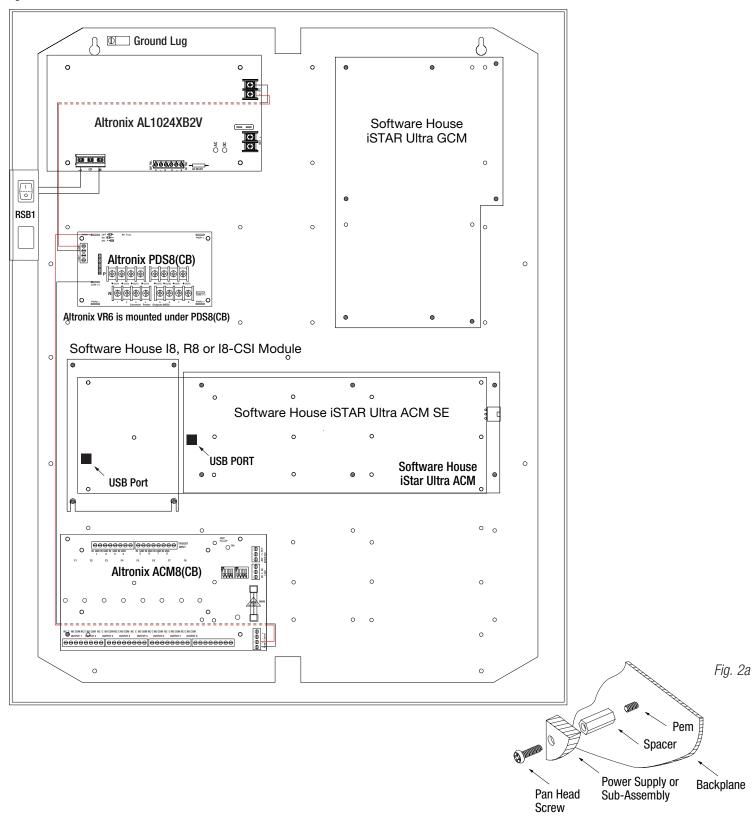

Trove Software House XBV Kits Installation Guide - 3 -

T3SK758V and T3SK758DV: Configuration of Software House iSTAR Ultra ACM Boards

- 1. Align the Software House boards on the backplane to match the boards' mounting holes with pems provided.
- 2. Fasten spacers (provided) to pems that match the hole pattern for Software House iSTAR Ultra GCM, iSTAR Ultra ACM, and/or I8, R8, I8-CSI boards (Fig. 3, 3a, pg. 4).
- 3. Mount Software House boards to spacers utilizing provided 5/16" pan head screws (Fig. 3a, pg. 4).

Note: Software House iSTAR Ultra ACM boards have one (1) USB port each.

Please orient the board in the appropriate position according to the Fig. 3 below.

4. Fasten backplane to Trove3 enclosure utilizing lock nuts (provided).

Fig. 3

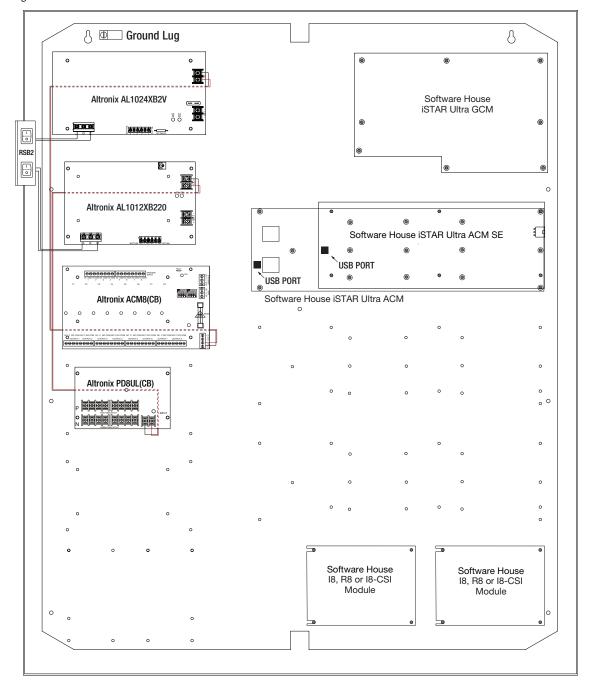


Fig. 3a

Power Supply or Backplane
Pan Head Sub-Assembly

Spacer

T3SK7516V and T3SK7516DV: Configuration of Software House iSTAR Ultra ACM Boards


- 1. Align the Software House boards on the backplane to match the boards' mounting holes with pems provided.
- 2. Fasten spacers (provided) to pems that match the hole pattern for Software House iSTAR Ultra GCM, iSTAR Ultra ACM, and/or I8, R8, I8-CSI boards (Fig. 4, 4a, pg. 5).
- 3. Mount Software House boards to spacers utilizing provided 5/16" pan head screws (Fig. 4a, pg. 5).

Note: Software House iSTAR Ultra ACM boards have one (1) USB port each.

Please orient the board in the appropriate position according to the Fig. 4 below.

4. Fasten backplane to Trove3 enclosure utilizing lock nuts (provided).


Fig. 4

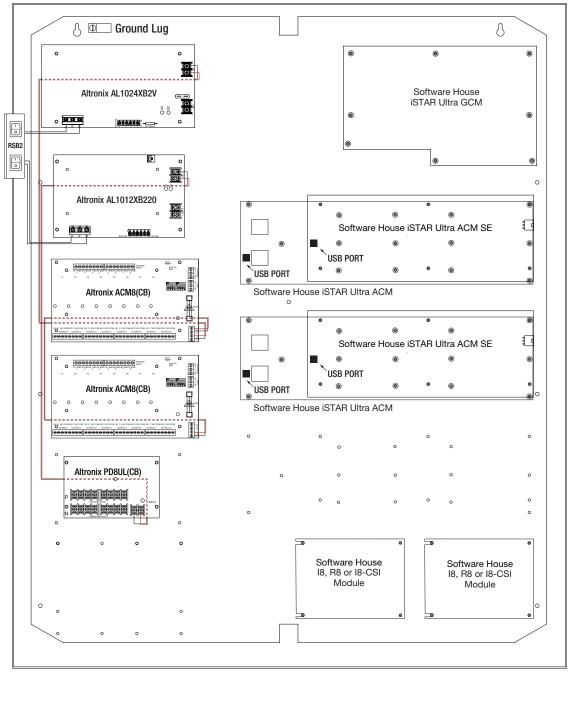

Notes:

T2SK78(D)V Enclosure Dimensions (H x W x D approximate):

27.25" x 21.5" x 6.5" (692.2mm x 552.5mm x 165.1mm)

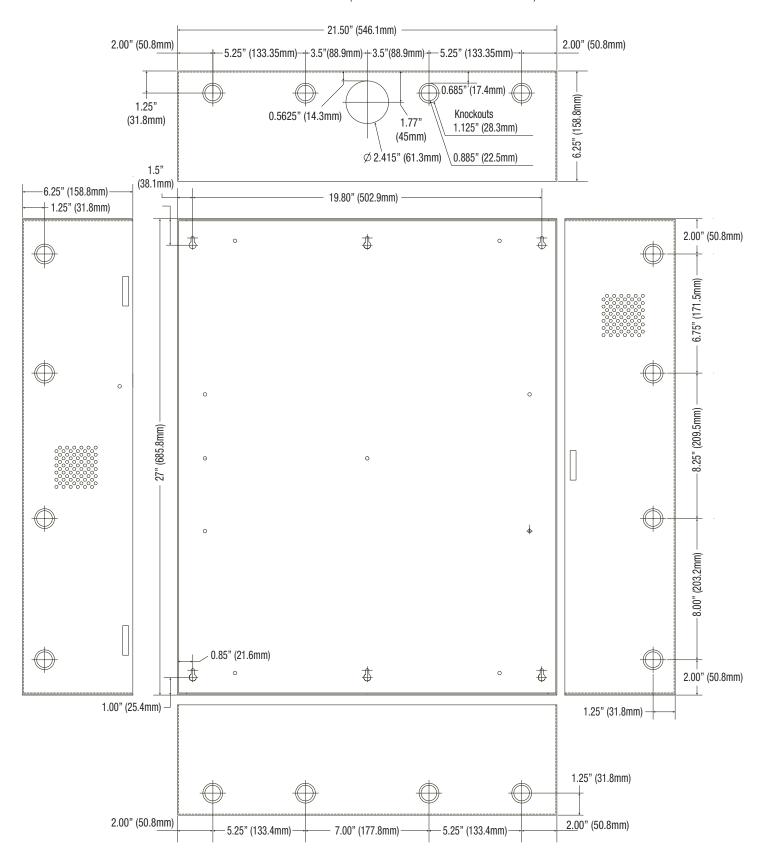

T3SK758(D)V and T3SK7516(D)V Enclosure Dimensions (H x W x D approximate):

36.12" x 30.125" x 7.06" (917.5mm x 768.1mm x 179.3mm)

